
	PRESENTATION FOLD FINISHED FOLDED SIZ		
	MINIMUM BLEED OF 0.125	" ALL AROUND IS REQUIRE	PL BE
-			
	BACK PA	ANEL	
	GHT FLAP	IA JOISTUO	

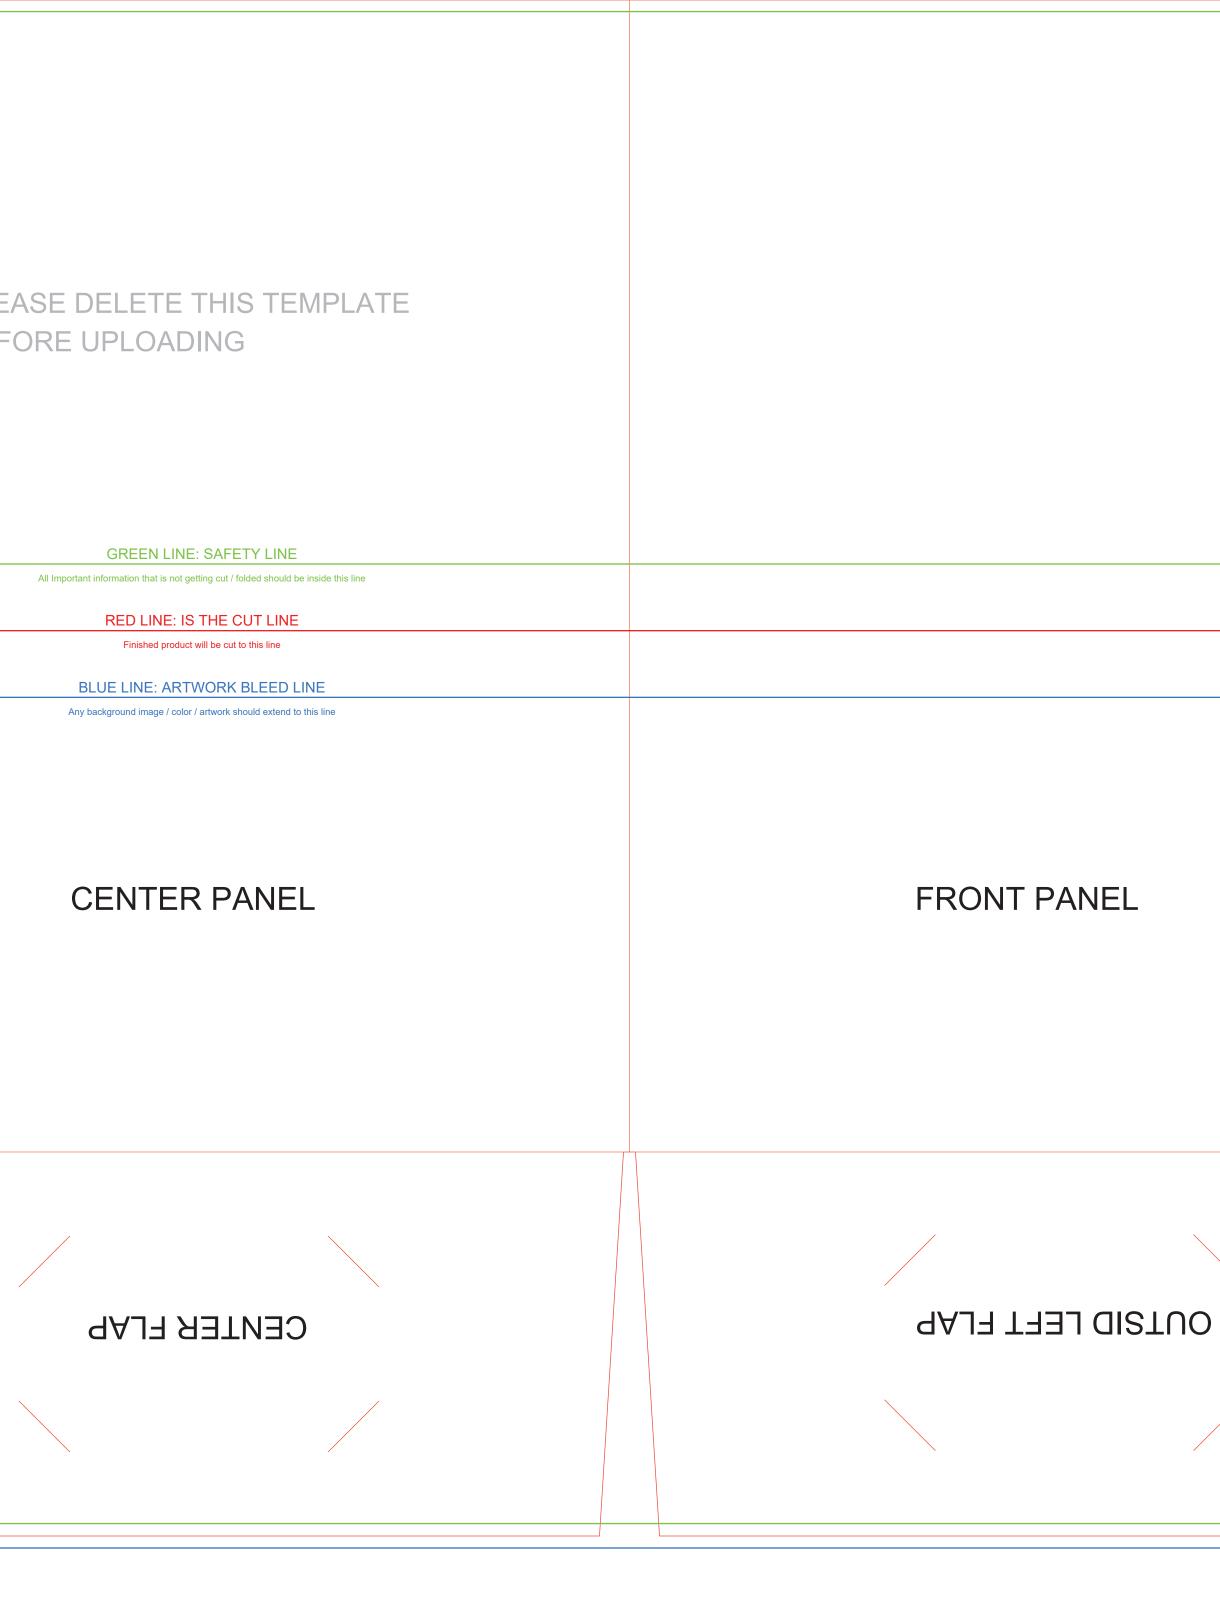

		-	
			
	┦		
	-		
			_
		[
	-		
N .			
/			
/			